


MOTOR OPERATED TRACTION POWER DISCONNECTS




4000 AMP 1000 VDC MOTOR OPERATED TRACTION POWER DISCONNECT FOR MOUNTING IN POWERSWITCH ENCLOSURE OR CUSTOMERS SWITCHGEAR



2000 AMP 1000 VDC MOTOR OPERATED TRACTION POWER DISCONNECT FOR MOUNTING IN POWERSWITCH ENCLOSURE OR CUSTOMERS SWITCHGEAR

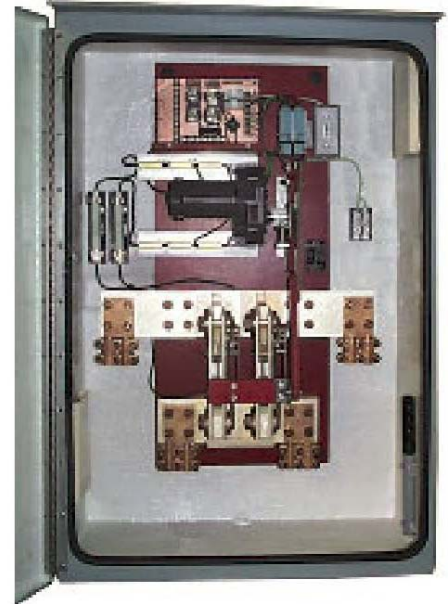

4000 AMP 1000 VDC MOTOR OPERATED TRACTION POWER DISCONNECT FOR STANCHION OR WALL MOUNTING

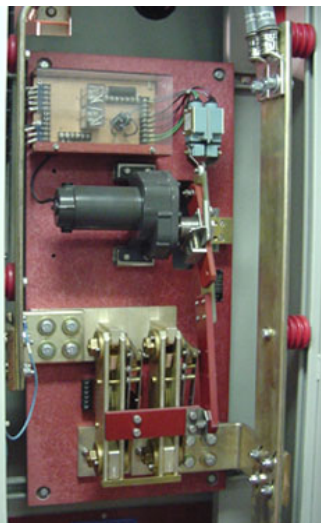

4000 AMP 1000 VDC MOTOR OPERATED TRACTION POWER DISCONNECT AS MOUNTED IN CUSTOMER'S SWITCHGEAR



4500 AMP 750 VOLT DC MOTOR OPERATED TRACTION POWER DISCONNECT FOR HORIZONTAL TRACK SIDE MOUNTING

POWERSWITCH Motor Operated Traction Power Disconnect Switches are made in accordance with specific contract specifications. Shown here are some examples of assemblies similar to as supplied for new facilities at DALLAS AREA RAPID TRANSIT, JFK AIRPORT, ST. LOUIS METROLINK, LIRR, PATCO and METRO-NORTH COMMUTER RAILROAD

POWERSWITCH, INC.

815 E. CHERRY ST.

TROY, MO 63379

PH 1-800-526-6740

FAX 636-528-8937

EMAIL: pssales@normandymachine.com